


















Maxi FF


jaga

Montagehandleiding / Instructions de montage
Montageanleitung / Mounting instructions










Energy
SAVERS
LOW-H₂O

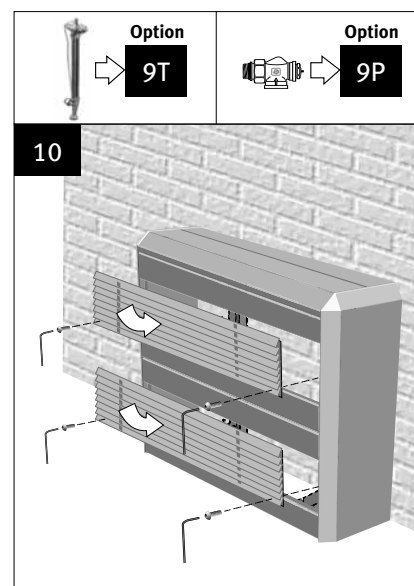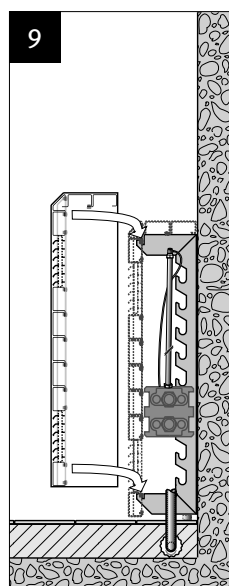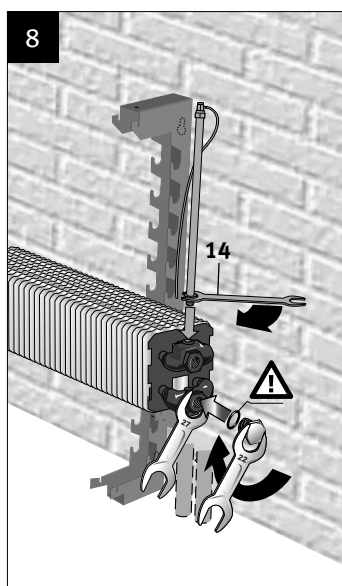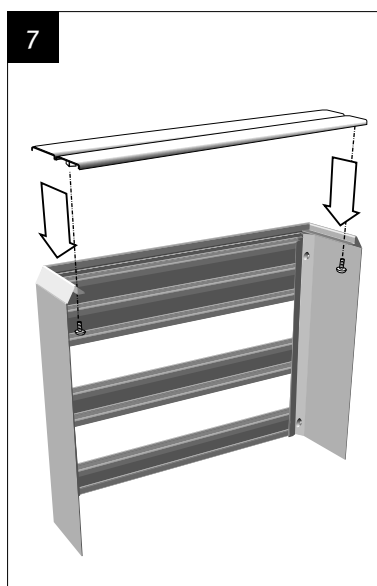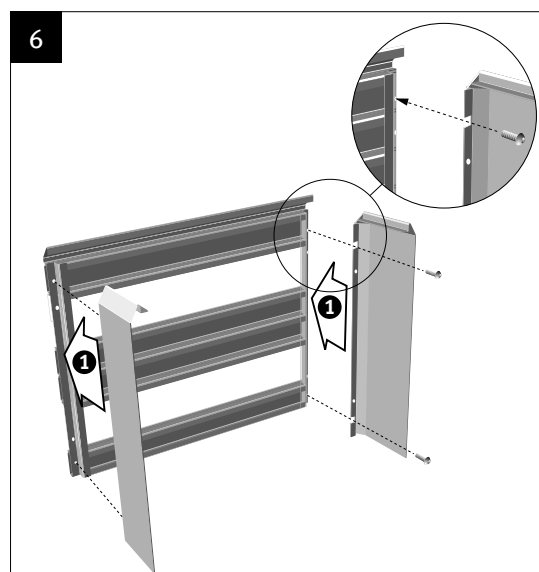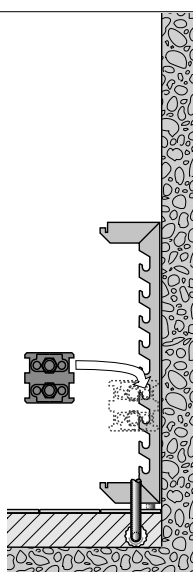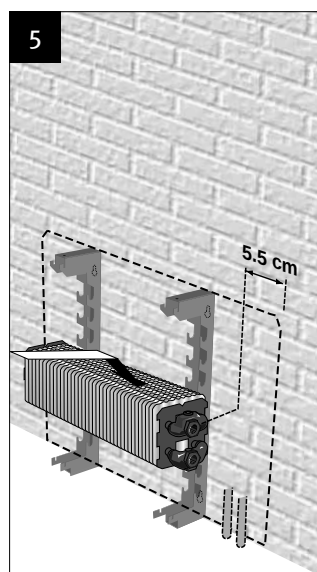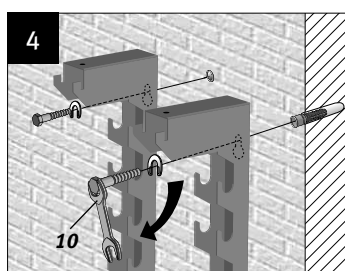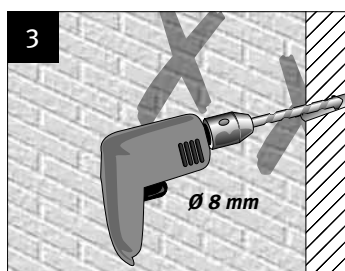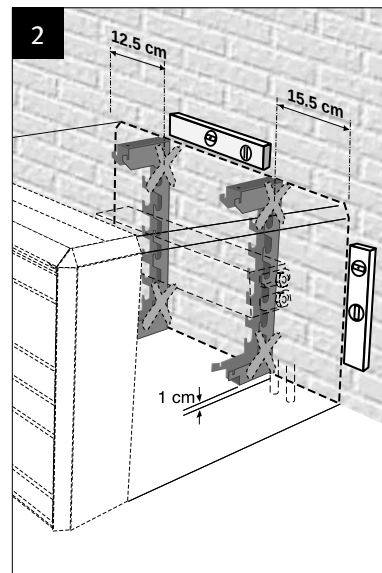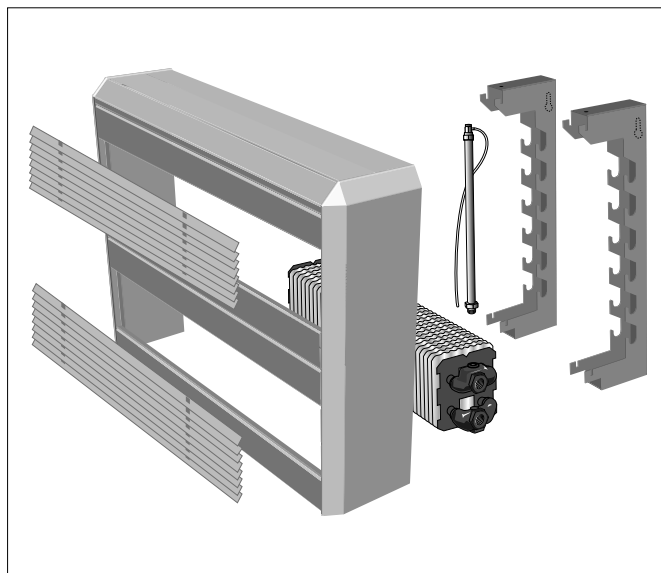

Montage met topventiel
Montage avec top vanne
Montage mit Topventil
Mounting with top valve



H	Code
44	5090.1300100
59	5090.1300400
74	5090.1300700

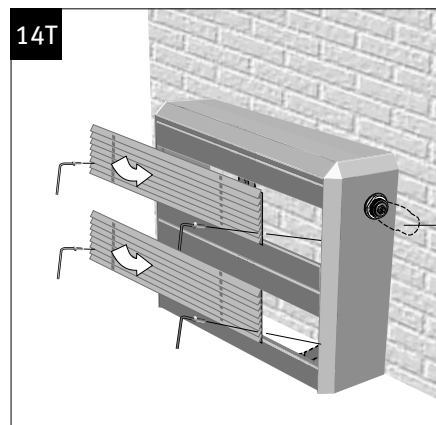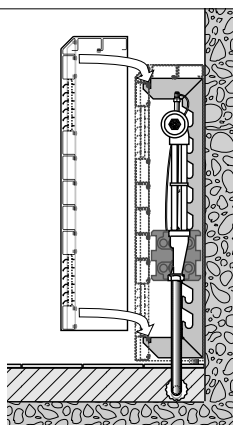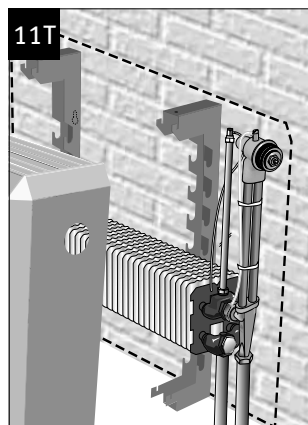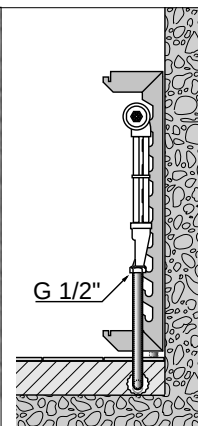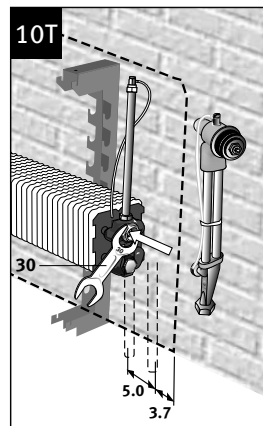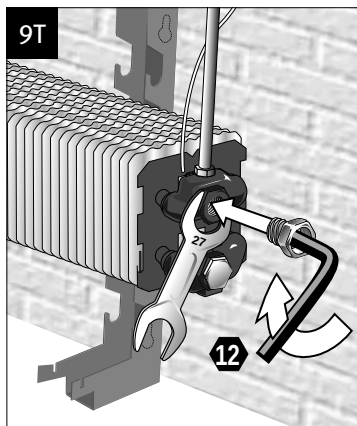

*OPTION








Montage met Jaga ventiel
Montage avec vanne Jaga
Montage mit Jaga Ventil
Mounting with Jaga valve

*OPTION



Code
5090.405 - standard Kv
5090.404 - small Kv

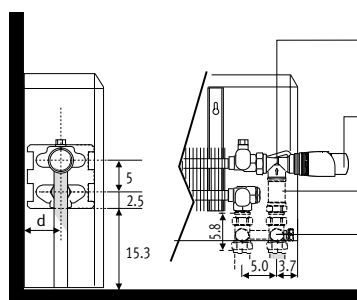

Jaga thermostaatventiel
Vanne Jaga thermostatique
Jaga Thermostatventil
Jaga thermostatic valve

*OPTIE / OPTION

Verlengpijp
Tube de rallonge
Verlängerungsrohr
Extension pipe
CODE 5090.108

H-Stuk 1/2" - M24
Raccord en H 1/2" - M24
H-Stück 1/2" - M24
H-Piece 1/2" - M24
CODE 5090.120

Type	d	*h/min
10-11	5.3	10
15-16	7.8	12
20-21	10.3	15

* Kleinere afstanden kunnen een lichte daling van de afgifte tot gevolg hebben.
* Des dimensions inférieures peuvent diminuer légèrement l'émission de chaleur.
* Kleinere Abstände verändern geringfügig die Wärmeleistung.
* Smaller dimensions can decrease output.

Montage slotjes
Montage serrures
Montage Verschlüsse
Mounting locks

